


Montageanleitung

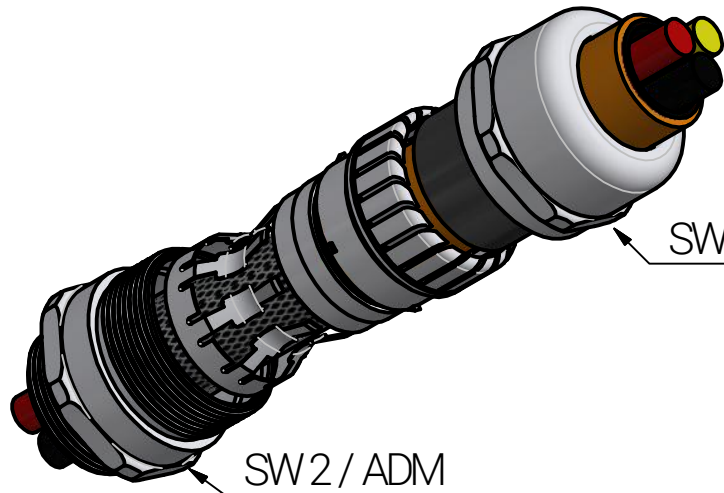


SW 1 / ADM

Schritt 3

SW 2 / ADM

Schritt 1
Schritt 2

Schritt 4

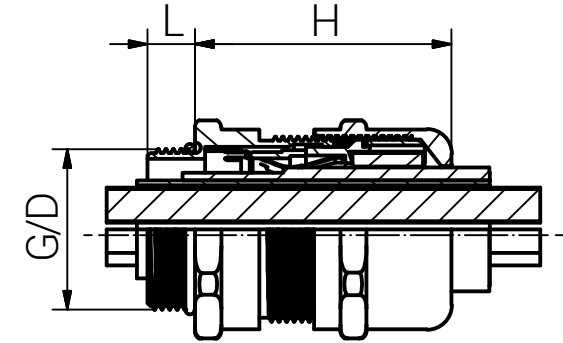

Artikel	Gewinde G	Klemmbereich (mm)		Klemmbereich Schirm (mm)		SW1 (mm)	SW2 (mm)	L (mm)	H max. (mm)	D (mm)	Durchgangs- bohrung (mm)	Anzugsdreh- moment (Nm) ADM		Kategorie der Schlagein- wirkung
		≥	≤	≥	≤							Hutmutter	Stützen	
61086512	M12x1,5	3,0	6,5	2,0	5,0	14	14	6,0	28,0	12,0	12 (0/+0,2)	5,0	5,0	2
61086516	M16x1,5	5,0	10,0	3,5	8,0	20	20	6,0	33,0	16,0	16 (0/+0,2)	6,0	6,0	2
61086520	M20x1,5	6,0	12,0	4,5	10,0	22	22	6,0	32,0	20,0	20 (0/+0,2)	6,0	6,0	2
61086522	M20x1,5	7,5	14,0	5,5	11,5	24	24	8,0	40,0	20,0	20 (0/+0,2)	10,0	6,0	2
61086525	M25x1,5	10,0	18,0	7,0	14,0	30	30	8,0	43,0	25,0	25 (0/+0,2)	15,0	6,0	4
61086532	M32x1,5	16,0	25,0	12,0	20,0	40	40	9,0	53,0	32,0	32 (0/+0,2)	22,0	6,0	4
61086540	M40x1,5	22,0	32,0	18,0	27,0	50	50	9,0	60,5	40,0	40 (0/+0,2)	42,0	12,0	4
61086550	M50x1,5	30,0	38,0	26,0	34,0	58	58	9,0	73,0	50,0	50 (0/+0,2)	42,0	18,0	4
61086563	M63x1,5	34,0	44,0	30,0	40,0	64	68	14,0	59,0	63,0	63 (0/+0,2)	43,0	25,0	4
61086564	M63x1,5	37,0	53,0	33,0	49,0	75	75	10,0	72,0	63,0	63 (0/+0,2)	55,0	25,0	4

Schritt	Montageschritt (Die Installation sollte nur von einem qualifizierten Elektriker durchgeführt werden, der in der Installation von Kabelverschraubungen geschult ist.)
1	Kabelverschraubung mit dem Anschlussgewinde am Gegenstück (z.B. Elektronikgehäuse) montieren.
2	Stützen soweit anziehen, dass der O-Ring seine Funktion erfüllt. Als Richtwert gilt der in der Tabelle genannte ADM. Zu festes Anziehen kann zu Beschädigungen führen.
3	Kabel vorbereiten (abmanteln) und durch die Kabelverschraubungen führen, so dass das EMV-Element der Kabelverschraubung und die Schirmung des Kabels kontaktiert werden können.
4	Hutmutter soweit anziehen, dass der Dichteinsatz seine Funktion erfüllt und das EMV-Element und die Schirmung Kontakt haben. Zu festes Anziehen kann zu Beschädigungen führen.
Durchmesser des Montagelochs: - Gewindebohrung gemäß EN 60423 - Durchgangsbohrung siehe Tabelle.	
Zugentlastung gemäß EN 62444 : 2013 - Klemmbereich 3-4 mm = Rückhaltevermögen - Rest = Kategorie A	
IP-Schutzart ist IP 68 (5 bar / 30 min.) / IP 66 / IP 69.	



RST Rabe-System-Technik und Vertriebs-GmbH
Otto-Lilienthal-Strasse 19
49134 Wallenhorst
☎ +49 5407 8766-0
☎ +49 5407 8766-99
✉ info@rst.eu

Unless otherwise specified on the drawing:
Metric Thread = EN 60423
PG Thread = DIN 40430
NPT Thread = ANSI B1.20.1
Tolerance: DIN ISO 2768-m
All dimensions in mm.




Abusive use, in particular reproduction and dissemination to third parties is not permitted. You can be punished by civil law. Technical changes are reserved.

		Date	Name
Draw.		09.07.2018	SL
Appr.		09.07.2018	KH
Norm			
Scale:			1:1,5
C	Schlageinwirkung	09.02.2023	SL
B	Text	09.11.2020	SL
A	Anzugsdrehmoment	20.03.2019	SL
Status	Modification	Date	Name

Material:
Messing, vern.

Euro-Top EMV M (4. Generation)		Drawing-Nr.:	1 of 1
		610865xx_SZM_TD_German	
Status		V21	


Mounting Instruction

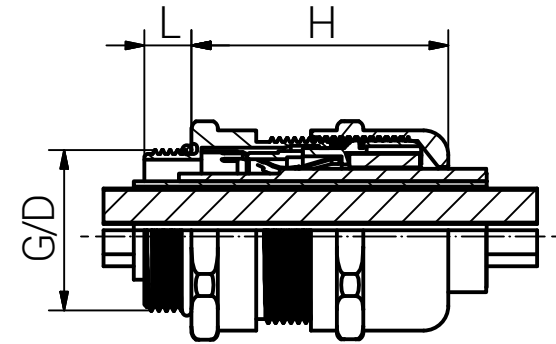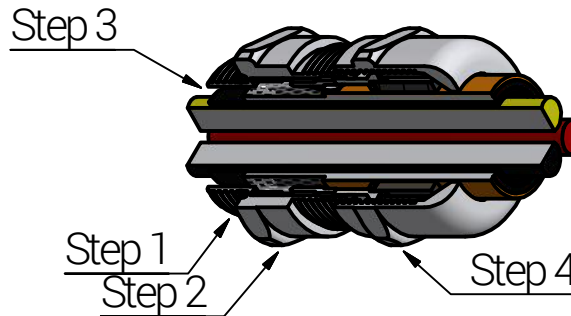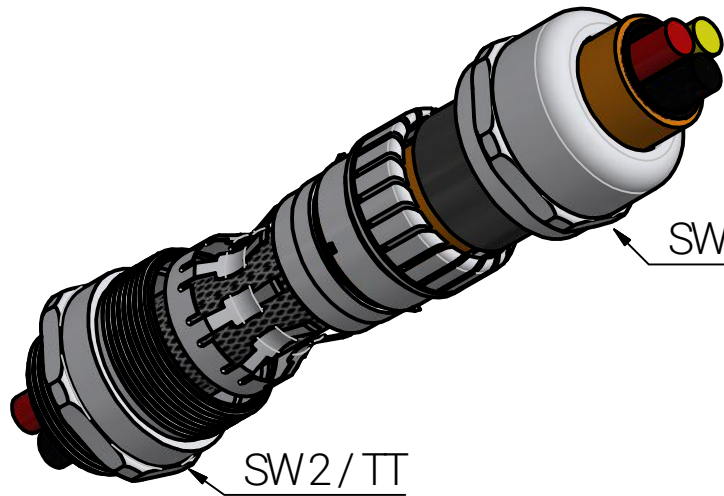

Article	Thread G	Clamping Range (mm)		Shield Diameter (mm)		SW1 (mm)	SW2 (mm)	L (mm)	H max (mm)	D (mm)	Non Threaded Enclosure (mm)	Tightening Torque (Nm) TT		Impact Category
		≥	≤	≥	≤							Cap	Body	
61086512	M12x1,5	3,0	6,5	2,0	5,0	14	14	6,0	28,0	12,0	12 (0/+0,2)	5,0	5,0	2
61086516	M16x1,5	5,0	10,0	3,5	8,0	20	20	6,0	33,0	16,0	16 (0/+0,2)	6,0	6,0	2
61086520	M20x1,5	6,0	12,0	4,5	10,0	22	22	6,0	32,0	20,0	20 (0/+0,2)	6,0	6,0	2
61086522	M20x1,5	7,5	14,0	5,5	11,5	24	24	8,0	40,0	20,0	20 (0/+0,2)	10,0	6,0	2
61086525	M25x1,5	10,0	18,0	7,0	14,0	30	30	8,0	43,0	25,0	25 (0/+0,2)	15,0	6,0	4
61086532	M32x1,5	16,0	25,0	12,0	20,0	40	40	9,0	53,0	32,0	32 (0/+0,2)	22,0	6,0	4
61086540	M40x1,5	22,0	32,0	18,0	27,0	50	50	9,0	60,5	40,0	40 (0/+0,2)	42,0	12,0	4
61086550	M50x1,5	30,0	38,0	26,0	34,0	58	58	9,0	73,0	50,0	50 (0/+0,2)	42,0	18,0	4
61086563	M63x1,5	34,0	44,0	30,0	40,0	64	68	14,0	59,0	63,0	63 (0/+0,2)	43,0	25,0	4
61086564	M63x1,5	37,0	53,0	33,0	49,0	75	75	10,0	72,0	63,0	63 (0/+0,2)	55,0	25,0	4

Step	Assembly Steps (The installation should only be done by a qualified electrician who are trained in the installation of cable glands.)
1	Mount the cable gland with the connection thread on the counterpart (e.g. electronic enclosure).
2	Tighten the body until the O-Ring fulfills its function. The guiding value is the TT mentioned in the table. Over tightening may cause damage.
3	Prepare the cable (dismantle) and pass it through the cable gland so that the EMC element of the cable gland and the shielding of the cable can be contacted.
4	Tighten the cap until the seal fulfills its function and that the EMC element and the shielding are in contact. Over tightening may cause damage.

Diameter of the mounting hole: - Threaded hole according to EN 60423 - Through hole see table.	
Type of cable anchorage according to EN62444:2013 - Clamping range 3-4mm = cable retention - Balance = Category A	
Degree of protection: IP 68 (5 bar / 30 min.) / IP 66 / IP 69.	

	RST Rabe-System-Technik und Vertriebs-GmbH Otto-Lilienthal-Strasse 19 49134 Wallenhorst ☎ +49 5407 8766-0 📠 +49 5407 8766-99 ✉ info@rst.eu		Unless otherwise specified on the drawing: Metric Thread = EN 60423 PG Thread = DIN 40430 NPT Thread = ANSI B1.20.1 Tolerance: DIN ISO 2768-m All dimensions in mm.		Abusively use, in particular reproduction and dissemination to third parties is not permitted. You can be punished by civil law. Technical changes are reserved.																						
	<table border="1"> <tr> <td></td> <td>Date</td> <td>Name</td> </tr> <tr> <td>Draw.</td> <td>16.07.2018</td> <td>SL</td> </tr> <tr> <td>Appr.</td> <td>16.07.2018</td> <td>KH</td> </tr> <tr> <td>Norm</td> <td></td> <td></td> </tr> <tr> <td>Scale:</td> <td></td> <td>1:1,5</td> </tr> </table>		Date	Name	Draw.	16.07.2018	SL	Appr.	16.07.2018	KH	Norm			Scale:		1:1,5	Material: Nickel Plated Brass		Drawing-Nr.: 610865xx_SZM_TD_Englisch		<table border="1"> <tr> <td>1</td> <td>of 1</td> </tr> <tr> <td colspan="2">A4</td> </tr> <tr> <td colspan="2">V17</td> </tr> </table>		1	of 1	A4		V17
	Date	Name																									
Draw.	16.07.2018	SL																									
Appr.	16.07.2018	KH																									
Norm																											
Scale:		1:1,5																									
1	of 1																										
A4																											
V17																											
Status	Modification	Date	Name	Z:\Inventor\Montageanleitung\Euro-Top-EMV-4.Generation\610865xx_SZM-TD\Euro-Top-EMV-04-1-BT-0001-610865xx_SZM_TD_Englisch.idw																							

Please note that the above representation is just a dimension illustration.